


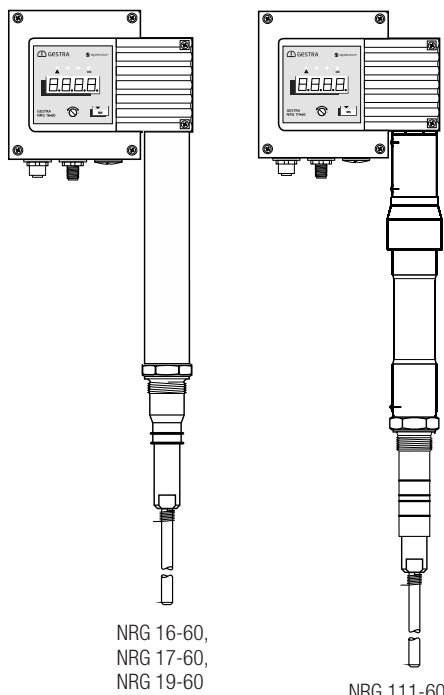

NRG 16-60,  
NRG 17-60,  
NRG 19-60

NRG 111-60

## Level Electrodes

### NRG 16-60 NRG 17-60 NRG 19-60 NRG 111-60

#### Description

In combination with the URS 60 / URS 61 safety control unit, NRG 1x-60 level electrodes are suitable for safety functions up to SIL 3.

They are elements of a safety circuit up to SIL 3 as per IEC 61508 in the SPECTORconnect system, and can transmit alarm notifications.

The level electrode uses the principle of conductive measurement and monitors itself. This means that a leaking or contaminated electrode insulator and/or a fault in the electrical connection trigger an alarm.

Alarms and error messages are displayed by LEDs and an operating unit. They are also saved in the level electrode and transferred to the URS 60 / URS 61 safety control unit using the CANopen protocol.

The NRG 1x-60 can indicate the minimum fill level in electrically conductive fluid:

- A fill level with a switchpoint.
- An NRG 1x-60 level electrode can be installed in a protective tube or level pot together with an NRG 1x-61 level electrode or continuous GESTRA NRG 26-60 level electrode.
- NRG 1x-60 level electrodes are used in conjunction with the URS 60 / URS 61 safety control unit as water level limiters for steam boiler and hot-water plants.

Water level limiters switch off the heating when the water drops below the set minimum level (LW).

Visualisation and operation take place via the URB 60 control terminal or SPECTORcontrol operating unit.

#### Function

Conductive level measurement based on the conductivity measurement principle. Some liquid substances are conductive, i.e. electric current can flow through them. To ensure this method functions reliably, the substance being measured must have a certain minimum conductivity.

#### The conductive measuring process delivers two findings:

- Electrode rod immersed or electrode rod not immersed, or in other words switchpoint reached or not reached.

Before installation, the length of the electrode rod must be adapted to match the point at which switching must take place, e.g. for switching off the burner and interrupting the safety circuit.

#### Behaviour in the event of an alarm

- When the water drops below the minimum level, the level electrode is no longer immersed and the URS 60 / URS 61 safety control unit triggers an alarm.
- If an additional electrode is installed, the insulated section between the measuring electrode and earth is independently monitored. If the value is below the admissible resistance value, the safety circuit is interrupted and burner switch-off is initiated.

#### Automatic self-test

An automatic self-test cyclically monitors the safety and function of the level electrode and measured value acquisition.

#### Technical data

##### Model and mechanical connection

- NRG 16-60, NRG 17-60, NRG 19-60, thread G¾ A, EN ISO 228-1
- NRG 111-60, thread G1 A, EN ISO 228-1

##### Nominal pressure rating, admissible service pressure and temperature

|              |        |                         |
|--------------|--------|-------------------------|
| ■ NRG 16-60  | PN 40  | 32 bar (abs) at 238°C   |
| ■ NRG 17-60  | PN 63  | 60 bar (abs) at 275 °C  |
| ■ NRG 19-60  | PN 160 | 100 bar (abs) at 311°C  |
| ■ NRG 111-60 | PN 320 | 183 bar (abs) at 357 °C |

##### Materials

- Terminal box 3.2581 G AISi12, powder-coated
- Cover tube 1.4301 X5 CrNi 18-10
- Electrode extension 1.4401 or 1.4404
- Electrode insulation  
NRG 16-60, NRG 17-60, NRG 19-60 Gylon®
- Electrode insulation NRG 111-60, special ceramic
- **Screw-in body:**
  - ◆ NRG 16-60, NRG 17-60, NRG 19-60  
1.4571, X6CrNiMoTi17-12-2
  - ◆ NRG 111-60 1.4529, X1NiCrMoCuN25-20-7

##### pH value

- NRG 111-60 Maximum admissible = 10

##### Electrode lengths supplied

- 500 mm, 1000 mm, 1500 mm, 2000 mm, 2500 mm, 3000 mm
- The electrode extension can be shortened

##### Conductivity range at 25°C

- 0.5 µS/cm to 10,000 µS/cm

##### Sensitivity

- 0.1 µS/cm at an immersion depth of 5 mm, with enlarged measuring surface

##### Supply voltage

- 24 V DC ± 20%

##### Power consumption

- Max. 7 W

##### Current input

- Max. 0.3 A

##### Internal fuse

- T2A

##### Safety cutout at excessive temperature

- Cutout occurs when an excessive temperature = 75°C is measured in the electrode tip

##### Electrode voltage

- Approx. 2 VSS at no load

## Level Electrodes

### NRG 16-60

### NRG 17-60

### NRG 19-60

### NRG 111-60

#### Input/output

- Interface for CAN bus to ISO 11898, CANopen, insulated
- M12 CAN bus connector, 5-pin, A-coded
- M12 CAN bus socket, 5-pin, A-coded

#### Indicators and controls

- 1 x green 4-digit, 7-segment display for showing status information
- 1 x red LED for indicating an alarm
- 1 x green LED for indicating an OK state
- 1 x rotary knob IP65 with button for menu navigation and test function

#### Protection class

- III Safety Extra Low Voltage (SELV)

#### IP rating to EN 60529

- IP 65

#### Admissible ambient conditions

- Service temperature: 0 °C - 70 °C
- Storage temperature: - 40 °C - 80 °C
- Transport temperature: - 40 °C - 80 °C
- Air humidity: 10 % - 95 %, non-condensing)

#### Weight

- NRG 16-60, NRG 17-60, NRG 19-60 approx. 2.1 kg
- NRG 111-60 approx. 2.7 kg

#### Admissible installation positions

- Vertical
- Oblique to a maximum inclination of 45°. In this case, the length of the electrode rod is limited to 1000 mm maximum.

## Directives and standards

You can find details on the conformity of the equipment and the applicable standards and directives in our Declaration of Conformity and the relevant certificates or approvals.

Please note our general terms of business.

The data are transferred to the URS 60/URS 61 safety control unit in the form of a black channel data telegram via the CANopen protocol using a CAN bus to ISO 11898, and saved there.

In total, two NRG 1x-60 level electrodes can be operated in conjunction with a URS 60 / URS 61 safety control unit as a water level limiter system.

## Important notes

Use a shielded, multi-core, twisted-pair control cable, e.g. UNITRONIC® BUS CAN 2 x 2 x .. mm<sup>2</sup> or RE-2YCYV-fl 2 x 2 x .. mm<sup>2</sup> as the bus line.

Pre-wired control cables (with connector and coupling) are available as accessories in various lengths.

The baud rate is determined by the line length (transfer rate) between the bus terminal devices, and the conductor size is determined by the overall current input of the measuring sensors.

0.2 A at 24 V is required per sensor. With five sensors, there is therefore a voltage drop of approx. 8 V per 100 m when using cables of 0.5 mm<sup>2</sup>. In this case, the system is operating at its limits.

With five or more sensors and a cable length of ≥ 100 m, the wire cross-section needs to be doubled to 1.0 mm<sup>2</sup>.

At larger distances of > 100 m, the 24 V DC supply can also be connected on site.

If a level electrode is installed in a lockable level pot outside the boiler, the connecting pipes must be flushed regularly. An SRL 6-60 monitoring unit is additionally required to monitor the flushing times and flushing process.

## How to order and specify:

### Level electrode

| Type:        | Stock code: |
|--------------|-------------|
| ■ NRG 16-60  | 38310.. xx  |
| ■ NRG 17-60  | 38320.. xx  |
| ■ NRG 19-60  | 38330.. xx  |
| ■ NRG 111-60 | 38340.. xx  |

| Electrode length L (mm)     |   |      | xx |
|-----------------------------|---|------|----|
| L1                          | + | L2   |    |
|                             |   | 0    | 40 |
| NRG 16-/17-/19-60           |   | 500  | 41 |
| L1 = 90 mm                  |   | 1000 | 42 |
|                             |   | 1500 | 43 |
| NRG 111-60                  |   | 2000 | 44 |
| L1 = 136 mm                 |   | 2500 | 45 |
|                             |   | 3000 | 46 |
| Measuring surface extension |   |      | 82 |

Fig. 1

### Additional modules:

- Safety control unit URS 60
- Safety control unit URS 61
- Visual display and operating unit URB 60 or SPECTORcontrol
- Monitoring unit SRL 6-60

## Dimensions

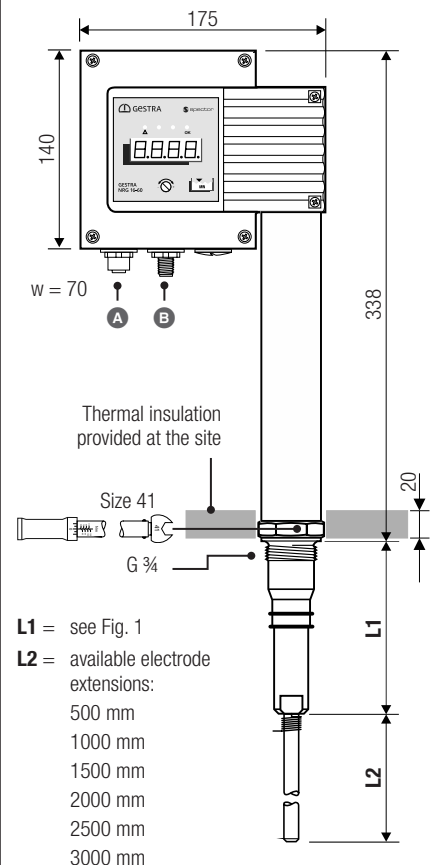


Fig. 2

## Connections

- A M12 CAN bus socket, 5-pin, A-coded
- B M12 CAN bus connector, 5-pin, A-coded

## Wiring diagram of CAN bus system

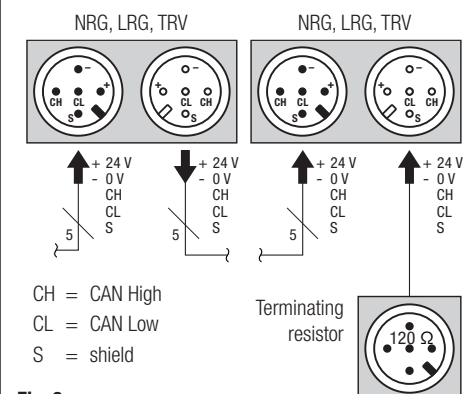


Fig. 3

# GESTRA GmbH

Münchener Straße 77, 28215 Bremen, Germany  
Tel. +49 421 3503-0, Fax +49 421 3503-393  
e-mail info@de.gestra.com, website www.gestra.com